


NOTE: STOP BOX TO BE 3" BACK OF SIDEWALK UNLESS OTHERWISE APPROVED.



NOTES: 1. OWNERS RESPONSIBILITY SHALL BE UP TO AND INCLUDING THE TUBE NUT WHICH THREADS ONTO THE METER YOLK.

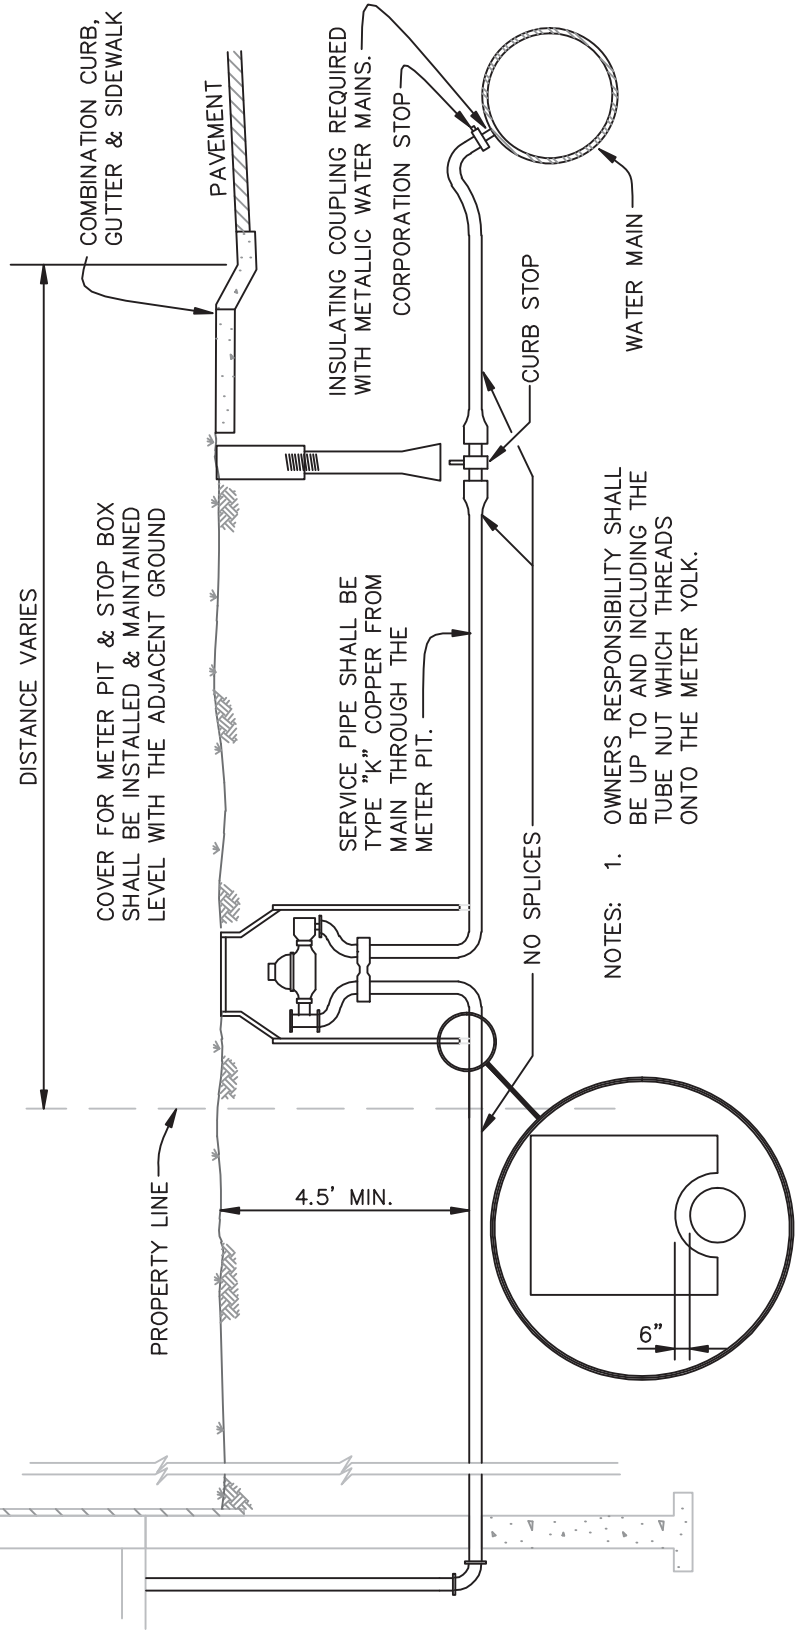

CITY OF FEDERAL HEIGHTS  
 COLORADO  
 STANDARDS DRAWINGS  
 MARCH 2010

3/4" & 1" SERVICE LINE  
 & OUTSIDE METER  
 INSTALLATION

DRAWING  
 #  
**3-2**