


PLAN OF PIPING
NO SCALE

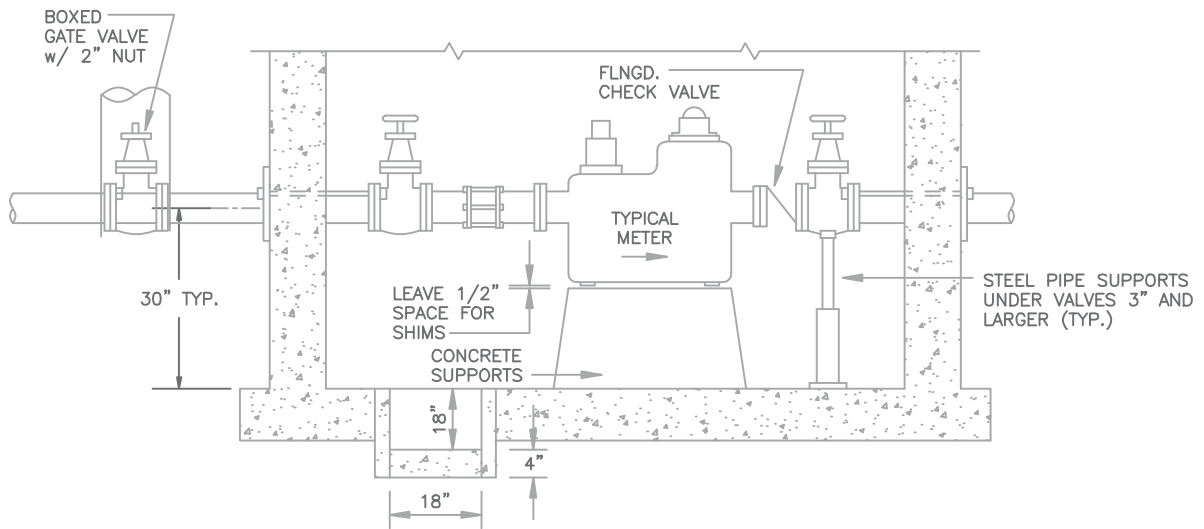

TYPICAL CONC. METER SUPPORTS
NO SCALE

NOTES:

1. PROVIDE ADJUSTABLE SUPPORT FOR METER AND BY-PASS
2. STRAINERS TO BE INSTALLED WITH ALL TURBINE METERS
3. ALL VALVES MUST BE RESILIENT WEDGE
4. ALL INTERIOR CONNECTIONS MUST BE FLG. X FLG.
5. ALL EXTERIOR CONNECTIONS MUST BE M.J. X M.J.



CITY OF FEDERAL HEIGHTS
COLORADO
STANDARDS DRAWINGS
MARCH 2010

STANDARD WATER METER PIT
3" & 4" METER SETTING DETAILS

DRAWING

3-9