



CLASS A  
CONCRETE CRADLE

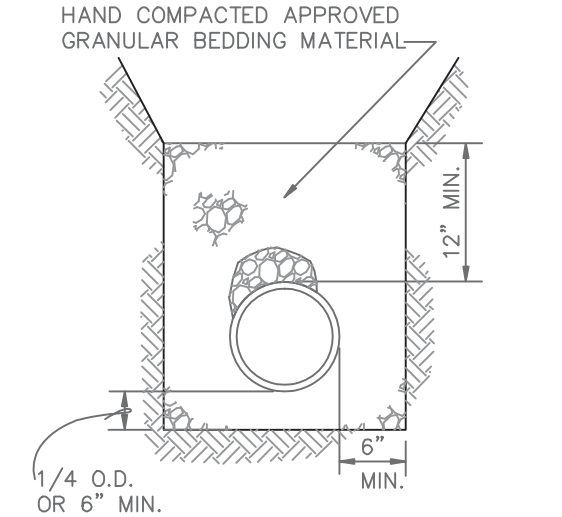

CLASS B  
COMPACTED GRANULAR  
BEDDING  
FOR 15" DIA. PIPE OR SMALLER

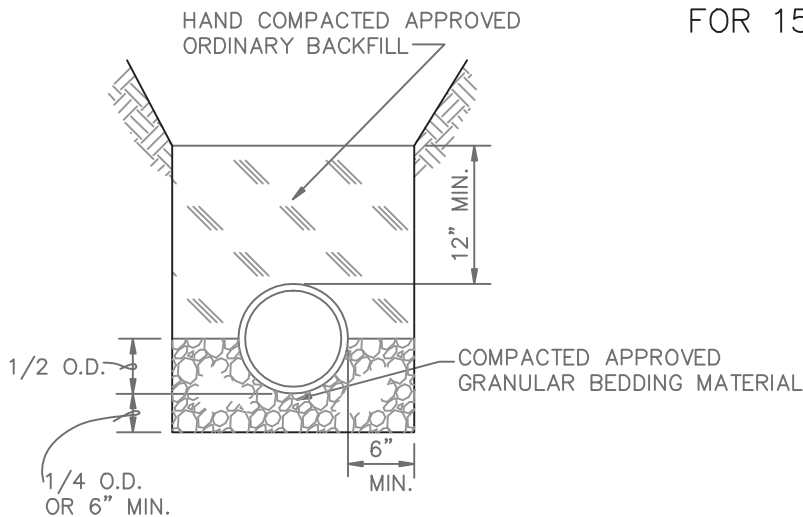

CLASS B  
COMPACTED GRANULAR  
BEDDING  
FOR 18" DIA. PIPE OR LARGER

NOTE:  
THERE SHALL BE A MINIMUM OF 30" OF BACKFILL  
OVER THE PIPE BEFORE OTHER THAN HAND COMPACTION  
EQUIPMENT IS USED IN THE TRENCH.



CITY OF FEDERAL HEIGHTS  
COLORADO  
STANDARDS DRAWINGS  
MARCH 2010

STANDARDS DRAWING

PIPE BEDDING  
FOR SEWER MAINS

DRAWING

#

4-5